


URINAL ELEVATION


DISPENSER ELEVATIONS

## ACCESSIBLE RESTROOM NOTES

- I. Where separate facilities are provided for non-disabled persons of each sex, separated facilities shall be provided for persons with disabilities of each sex also.
- 2. Whe're facilities are to be used by small children, the specific heights may be adjusted to meet their accessibility needs.
- 3. Faucet controls and operating mechanisms shall be operable with one hand and shall not require tight grasping, pinching, or twisting of the wrist (i.e, use lever-operated, push-type, etc.). The force to activate controls shall not exceed 5 lbs. Self-closing valves are allowed if the faucet remains open for at least 10 seconds.
- 4. The force required to activate the flush valve shall be 5 lbs. maximum and located 44" maximum above the floor.
- 5. Stall doors shall be equipped with an automatic-closing device, and shall have a clear, unobstructed opening of 32" when located at the end and 34" when located at the side with the door positioned at an angle of 90 degrees from its closed position.
- 5. The inside and outside of the stall door shall be equipped with a loop or "U"-shaped handle immediately below the latch. The latch shall be flip-over style, sliding, or other hardware not requiring the user to grasp or twist.
- 7. Where 6 or more stalls are provided within a multiple accommodation toilet room, at least one additional stall shall comply with Section 1115B.7.1.2 and 115B7.1.3.



## ACCESSIBLE GRAB BARS

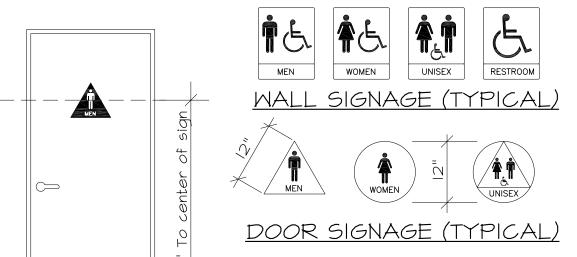

Signs shall be 1/4" thick, with lettering raised 1/32", uppercase letters, between 5/8" to 2" high, and contrasting color. Wall signs shall be located on the latch side with corresponding grade II Braille.



in understanding | DEVELOP

ner and Address:

rigies over the control of the contr

Standard Accessibility Details and Notes for Handicapped Restrooms

 $\frac{0.0 \, \text{L}}{\text{HC}-4}$ 

SHEET OF