


**NOTES:**

1. TO MUNICIPAL WATER SUPPLY PER PUBLIC WORKS PLATE 304 OR 305
2. WATER METER (1" MINIMUM) WITH ATTACHED TAILPIECE:
3. TYPE "M" COPPER OR P.V.C. PIPE (1 1/4" MIN.).
4. TYPE "M" COPPER PIPE.
5. INDICATING MAIN OR CONTROL VALVE (EXTERIOR LOCATION).
6. DOUBLE CHECK ASSEMBLY (USC APPROVED) WITH BALL VALVES (FEBCO 805Y OR APPROVED EQUAL). TEST COCKS TO BE INSTALLED FACING AWAY FROM WALL.
7. MINIMUM 1/2" DRAIN VALVE AND INSPECTORS TEST STATION.
8. DISCHARGE TO EXTERIOR.
9. FLOW SWITCH WIRED TO ALARM BELL WITH RETARD.
10. U.L./F.M. LISTED PRESSURE GAUGE.
11. DOMESTIC SHUT OFF VALVE.
12. BACKFLOW PREVENTERS SHALL BE TESTED BY A CERTIFIED TESTER IMMEDIATELY AFTER INSTALLATION.
13. INSTALLATION SHALL BE INSPECTED AND APPROVED BY CROSS CONNECTION CONTROL PRIOR TO ACVTIVATING. (PHONE 805/385-8155)

REV.	DATE

REV.	DATE

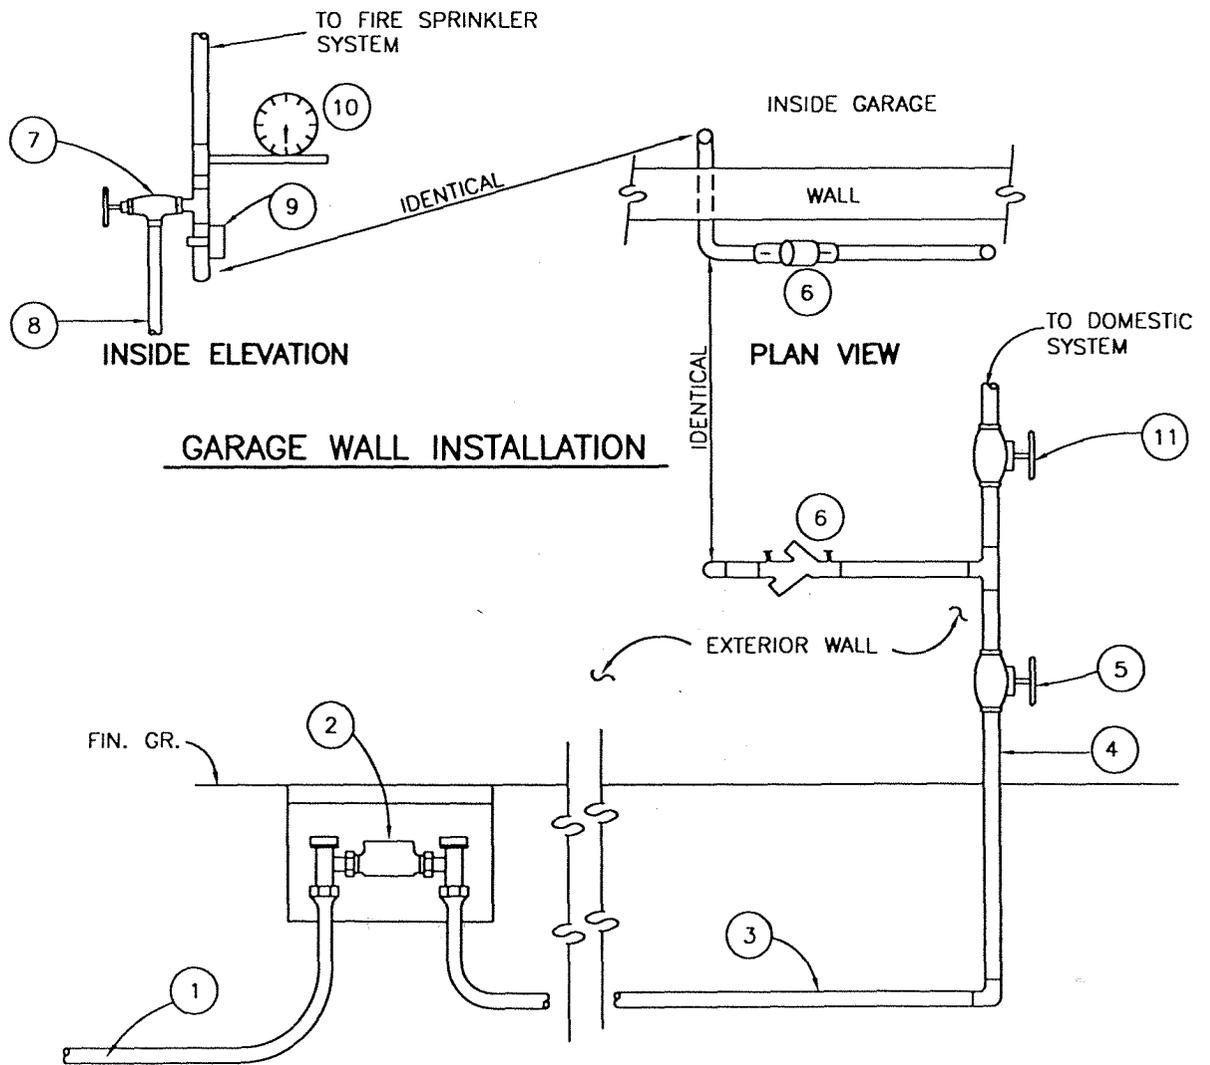

<p>CITY OF</p>	RESIDENTIAL FIRE LINE SERVICE		STANDARD PLAN 2002
	DRAWN: STAFF	CKD.: STAFF	PLATE 322
Department of Public Works		APPR. Granville M. Bowman	SHEET 1 OF 1