


REV.	APPR. BY	DATE

REV.	APPR. BY	DATE

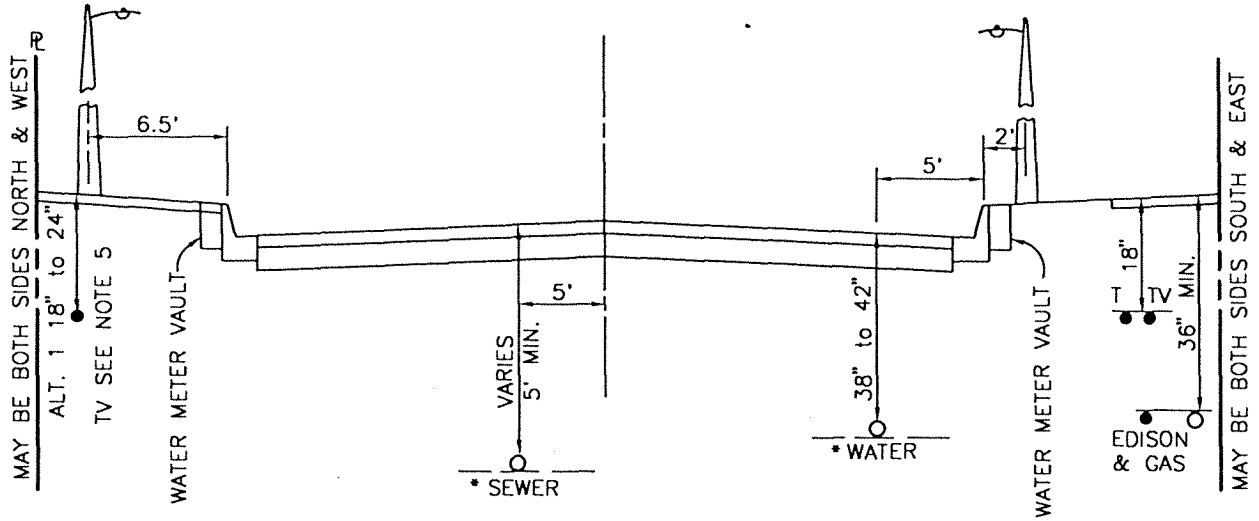

\* MINIMUM SEPARATION REQUIRED WHEN ELECTRICAL CROSSES BENEATH SEWER & WATER

### GENERAL NOTES

1. ALL INSTALLATIONS IN PUBLIC- RIGHT- OF WAY SHALL BE APPROVED BY THE CITY FOR LOCATION.
2. TWO COPIES OF PLANS DETAILING THE LOCATION OF ALL UNDERGROUND UTILITIES INSTALLED SHALL BE SUBMITTED BY THE SUBDIVIDER, OR THE PARTY MAKING THE INSTALLATION, TO THE CITY OF OXNARD FOR REVIEW AND APPROVAL.
3. CABLE TV SHALL CROSS STREETS (TRANSVERSE) AT DEPTH OF 36" PER STATE CODE.
4. TRENCH BACKFILL TO BE COMPACTED PER STANDARD SPECIFICATION OF PUBLIC WORKS CONSTRUCTION, SECTION 306-1.3.4 AND PLATE 602.
5. IN AREA PREVIOUSLY IMPROVED, CABLE TV SHALL BE INSTALLED PER ALT. 1.
6. DOES NOT COVER CONVENTIONAL UNDERGROUND ELECTRICAL SUBSTRUCTURES WITHIN RESIDENTIAL SUBDIVISION.
7. "AS-BUILTS" ARE REQUIRED FROM THE ENGINEER.
8. ENGINEERING STAKING MUST BE PROVIDED.
9. PERMIT FROM THE CITY IS REQUIRED FOR EACH TRENCH. DRY UTILITIES MAY SHARE A TRENCH.
10. IF WATER AND SEWER IS LOCATED AT A GREATER DEPTH THAN 6', SCE (750 VOLTS OR GREATER) WILL BE PERMITTED TO CROSS ABOVE SAME, BY USING P.C.C. IN A 4" MINIMUM THICKNESS ENCASEMENT, AS PER P.U.C..
11. ANY UTILITY CUTS ACROSS STREET WILL BE 90° TO STREET ALIGNMENT AND SHALL BE BACKFILLED WITH 2-SACK SLURRY.



CITY OF

## UNDERGROUND UTILITIES LOCATED IN STREET

STANDARD PLAN  
2002

DRAWN: STAFF

CKD.: STAFF

Department of Public Works

APPR.

*Granville M. Bowman*

Granville M. Bowman

PLATE 120

SHEET 1 OF 1